
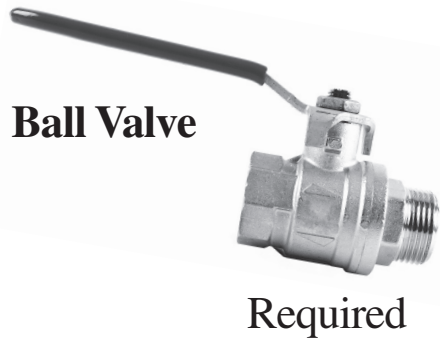


Minimum RLCWA Specifications

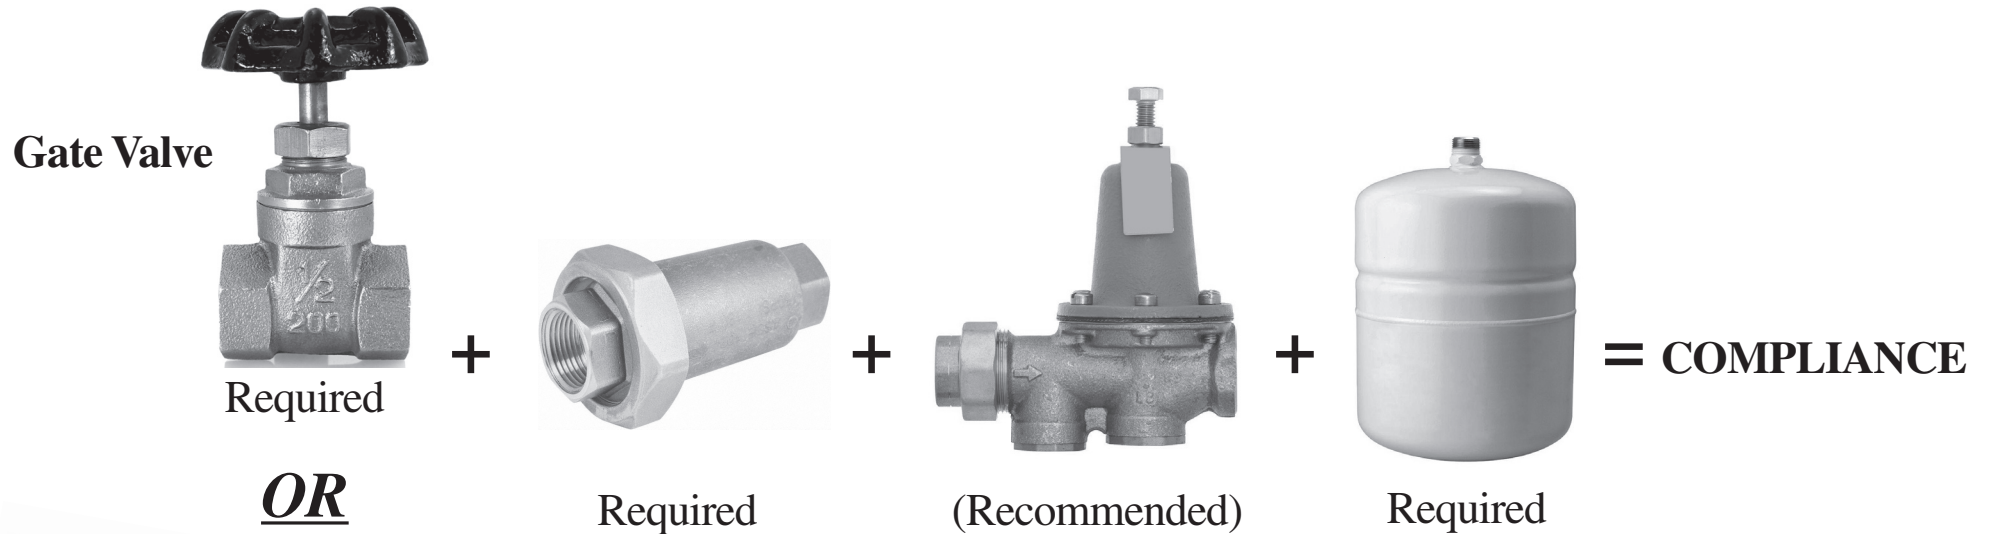

OR


ASSE 1024
Dual Check

Pressure
Regulating
Valve

Expansion
Tank

Boiler Feed Line with No Additives

=

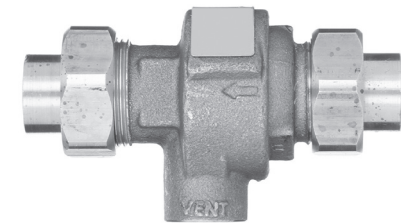

ASSE 1012
Dual Check with
Atmospheric Vent



RURAL LORAIN COUNTY WATER AUTHORITY

42401 State Route 303 • LaGrange, Ohio 44050 • Phone 440-355-5121 • Fax 440-355-6628

An inspection is REQUIRED after the plumbing has been completed. If you have questions please contact the backflow department at (440) 355-5121.